


TYPICAL PLAN VIEW - SETBACK SIDEWALK

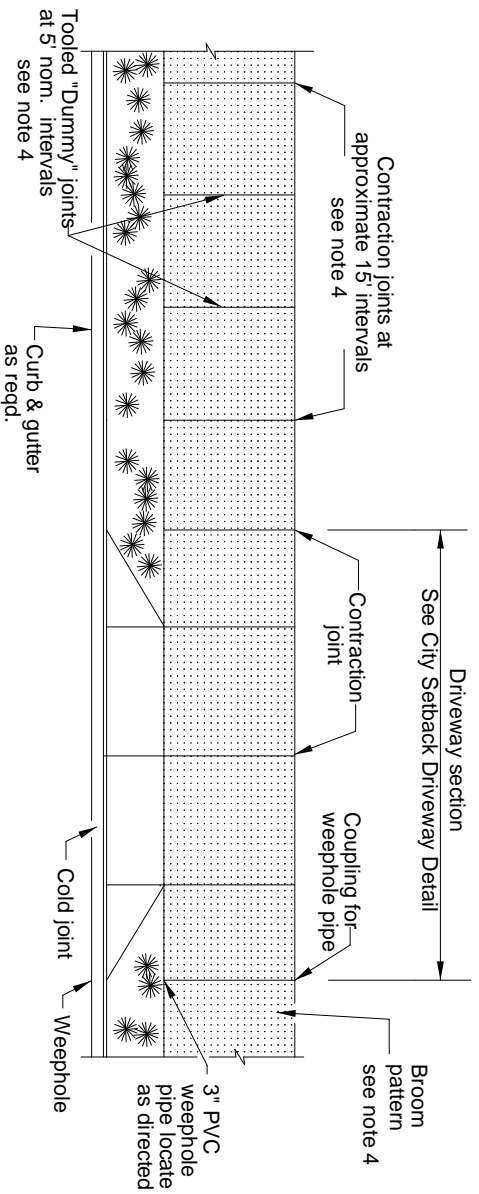

TYPICAL SETBACK SIDEWALK CROSS SECTION

* As specified in plans. Minimum 4". If sidewalk is a portion of a driveway or mountable curb is used minimum thickness 6".

General notes:

1. Include additional paved or unpaved 2' clearance to vertical faces higher than 5' such as retaining walls, sound walls, fences and buildings.
2. On sidewalks 8' and wider, provide a longitudinal joint at the midpoint.
3. Install 3" pvc weephole pipes in sidewalks in locations as directed by engineer. Place contraction joint over top of pipe.
4. Finish shall be medium broom with no shine marks.

<p>NOTE: All material and workmanship shall be in accordance with the current Oregon Standard Specifications</p>	
<p>OREGON STANDARD DRAWINGS CITY OF HOOD RIVER SETBACK SIDEWALK</p>	
DATE	REVISIONS
12 - 02	2002
	DESCRIPTION
	City of Hood River Modifications

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without consulting a Registered Professional Engineer.