



REQUIRED SIDEWALK WIDENING AROUND OBSTRUCTIONS

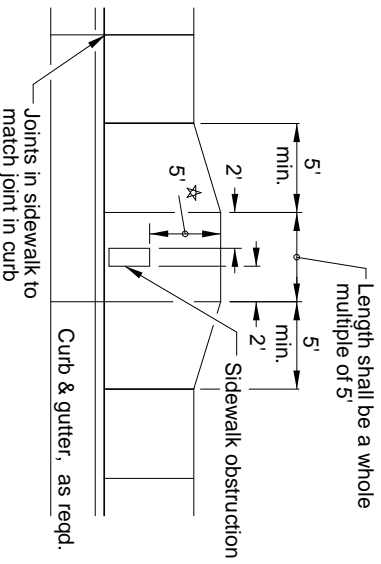

General notes:

1. Include additional paved or unpaved 2' clearance to vertical faces higher than 5' such as retaining walls, sound walls, fences and buildings.
2. On sidewalks 8' and wider, provide a longitudinal joint at the midpoint.
3. Install 3" pvc weephole pipes in sidewalks in locations as directed by engineer. Place contraction joint over top of pipe.

CLEAR CIRCULATION PATH

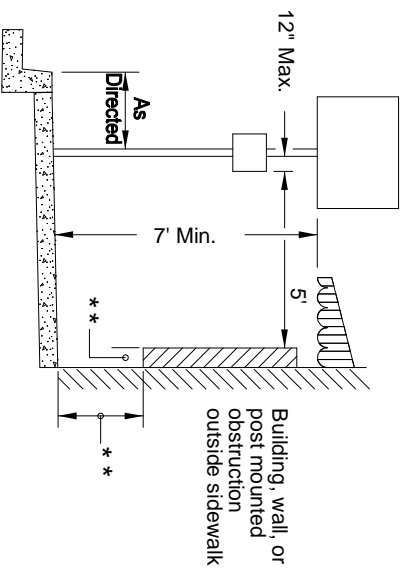

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without consulting a Registered Professional Engineer.

OREGON STANDARD DRAWINGS CITY OF HOOD RIVER SIDEWALK OBSTRUCTION STANDARDS

NOTE: All material and workmanship shall be in accordance with the current Oregon Standard Specifications
DATE: 12-02
REVISION DESCRIPTION: 2002
CITY OF HOOD RIVER INDICATORS