


Notes:

1. Valve box is to be Rich 910, 18" in length.
2. A 1/2" hole must be drilled through the valve box 6" below finish grade to allow locating wire to be placed through the side of the box.
3. Operator extension required when valve nut is deeper than 4' from finish grade.
4. Center valve box on axis of operator nut.
5. Valves 12" and smaller shall be provide with compacted agr. base on undisturbed ground. Valves greater than 12" shall be installed on precast concrete block.
6. Welds shall be minimum 1/4" all around.
7. Hot dip galvanize operator extension after fabrication.

COVER PLAN

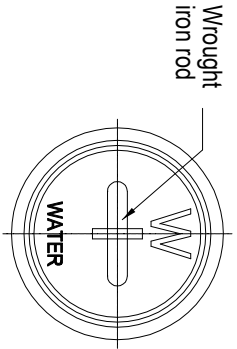

VALVE BOX EXTENSION SECTION (See note 3)

<p>NOTE: All material and workmanship shall be in accordance with the current Oregon Standard Specifications</p>	
<p>OREGON STANDARD DRAWINGS CITY OF HOOD RIVER VALVE BOX AND OPERATOR EXTENSION ASSEMBLY</p>	
DATE	REVISIONS
12-02	2002 City of Hood River Modifications

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without consulting a Registered Professional Engineer.